


AMEREN MISSOURI GAS TRANSPORT WIRING REQUIREMENTS

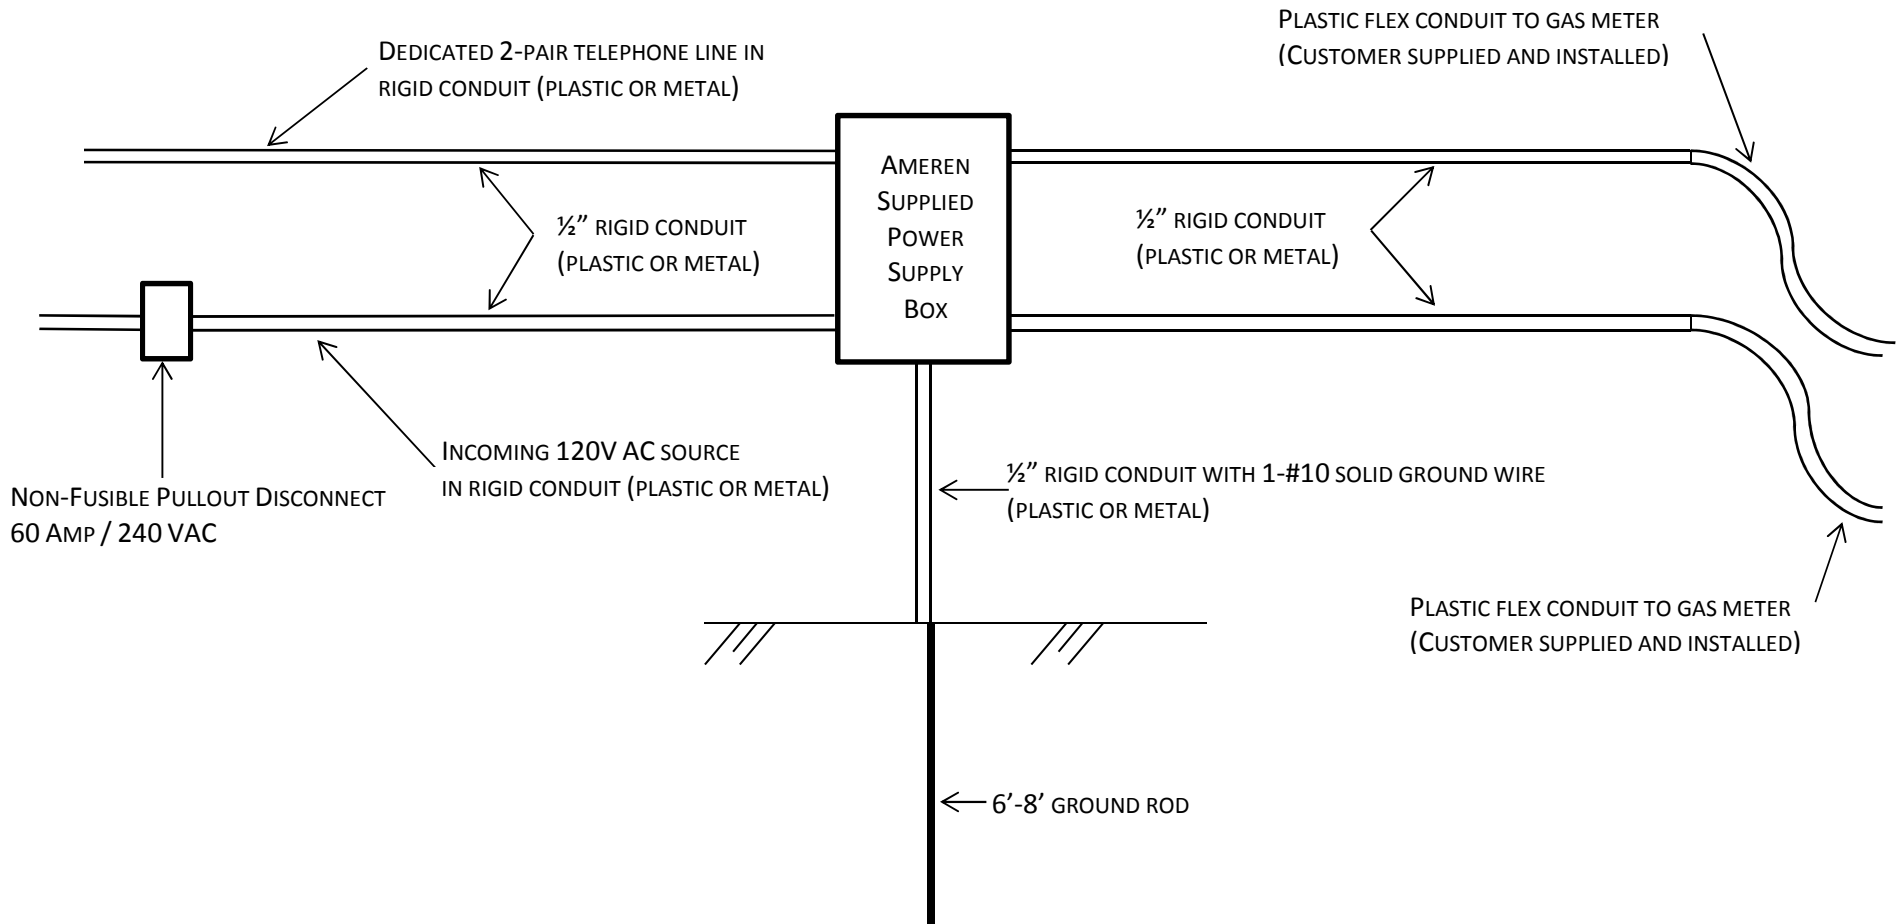

1. Power supply box provided by Ameren shall be mounted at least 5 feet from gas meter.
2. The customer is responsible for installing all equipment and landing the 120V AC source in the power supply box.
3. Enough wire should initially be ran to reach the power supply box and from the power supply box to the gas meter.
4. Two (2) solid #18 AWG wires shall be ran between the power supply box and the gas meter.
5. All rigid conduit shall be securely attached to building wall.

Note: After installation, the customer's responsibility will end at the power supply box, barring any extenuating circumstances or customer requested relocation work.